


# PECKCHEK CONTROLS (FOR SLIMLINE KINECHEKS)

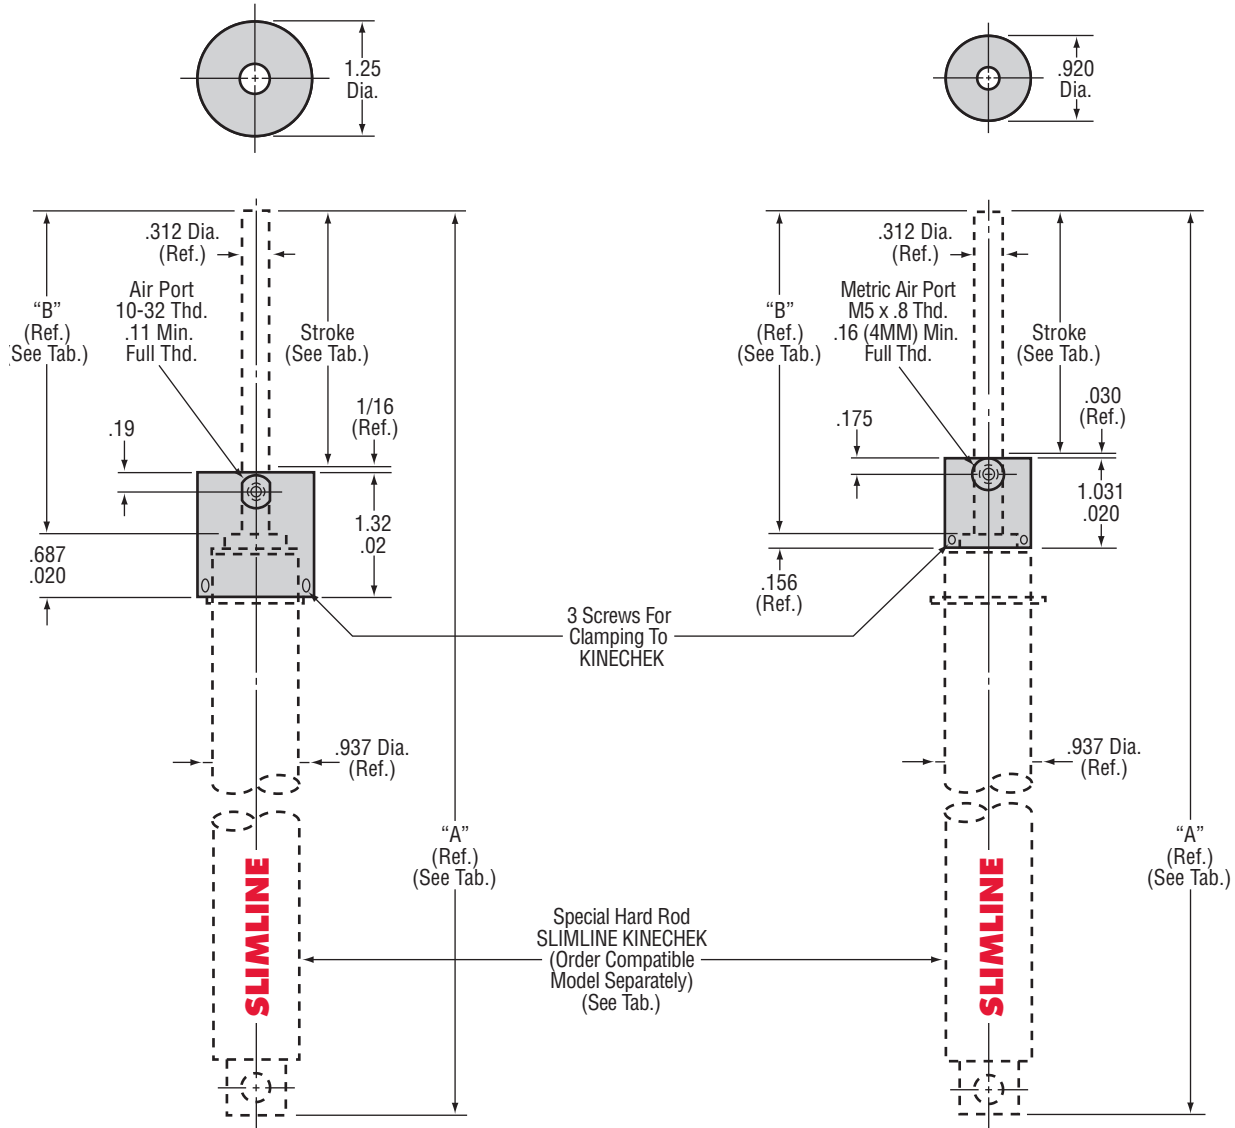

NOTE: Drawings not to scale

## A12031

### COMPATIBLE SLIMLINE KINECHEK MODELS\* FOR A12031

MODEL NO.	STROKE	A	B
1202-31-1	1 in.	8.33	1.69
1202-31-2	2 in.	11.37	2.69
1202-31-3	3 in.	14.37	3.69

\*Order Separately

## A13031

### COMPATIBLE SLIMLINE KINECHEK MODELS\* FOR A13031

MODEL NO.	STROKE	A	B
1202U-31-1	1 in.	8.55	1.91
1202U-31-2	2 in.	11.59	2.91
1202U-31-3	3 in.	14.59	3.91

\*Order Separately

## NOTES



**OPERATION-** Application of 25 to 125 psi air pressure will release clutch and extend plunger to ready KINECHEK for next operation. Maintain air pressure until plunger rod has extended. Remove air pressure for PECKCHEK operation and KINECHEK plunger rod will not extend during periodic withdrawals of tool for chip clearing.



**CAUTION-** A12031 and A13031 PECKCHEK CONTROLS must be operated only with a Model 1202-31-Tab or 1202U-31-Tab SLIMLINE KINECHEK which incorporates a specially hardened and polished plunger rod. Dimensions and performance for Model 1202 and 1202U-31 units are the same as shown in bulletin S-66 for the Model 1002-31 of the same stroke, except that the plunger rod will be longer per tabulated Dim. "B".